

DIVISION OF ENVIRONMENTAL HEALTH
100 CENTRAL AVE
CHEYENNE, WY 82001
(307) 633-4090 FAX: (307) 633-4038

Permit No. _____
Revised
ID 6885

CITY / COUNTY HEALTH DEPARTMENT

**"NOT TO BE USED"
FOR THE CONVEYANCE
OF PROPERTY** **PERMIT TO CONSTRUCT
OF PROPERTY TO INSTALL OR MODIFY A SMALL WASTEWATER FACILITY**

Legal: R 64 T 14 SEC _____ 33
Size of Lot: (acres) 35
Owner HIXSON RYAN NICOLE
Address PO BOX 21663
City CHEYENNE St WY Zip 82003
Phone (Hm) (307) 772-0120 Phone (Wk) (307) 630-0579
Installer/Contractor Paul's Well Svc / Robert Schumm
Type of Building RESIDENCE
Number of Bedrooms 3 1/2 (3)
Daily flow _____ 450
Septic Tank gallons Vaughn 1250 1000 11250 2 Comp
Secondary treatment CHAMBER @ 5 SQ FT E936
5 bedroom 750 flow

Property Add 3525 ANTELOPE MEADOWS DR
Lot/Tract: 44 Block _____
Subdivision ANTELOPE MEADOWS 3RD FILING
Well Installed: NO YES
Well to septic tank (50' min.) 159'
Well to final disposal (100' min.) 175'
Perc rate: 12 Load rate: 0.57
Depth of sewer rock:
above pipe 0 below pipe 0
Tank Material PRECAST CONCRETE
Sq. ft 800 width 5 lineal 160 (200')
1325 5 265

REMARKS:

MAINTAIN PROPER SETBACKS AND DEPTHS

Nothing in this permit constitutes an endorsement of the construction or the design of the facility described herein. This permit indicates only that standards of design and construction required by the Laramie County Small Wastewater Facilities Regulations have been met. The County or the City-County Health Department does not in any way guarantee the performance of any Small Wastewater Facility.

**"NOT TO BE USED"
FOR THE CONVEYANCE
OF PROPERTY**

I certify that the installation of the Small Wastewater Facility described in this permit will be in compliance with Minimum Standards for Small Wastewater Facilities.

APPLICANT'S SIGNATURE: _____ DATE: 11-23-04

CONTACT THIS OFFICE FOR INSPECTION TWENTY-FOUR (24) HOURS PRIOR TO COVERING INSTALLATION.


OFFICE USE ONLY
THIS PERMIT IS VALID FOR ONE YEAR FROM DATE OF ISSUANCE





ID# 10845
 Date 1/19/05
 Installer Paul's Well Svc./Robert Schumm
 Tank Sz 1250
 Tank Type VAUGHN 2-COMP
 #Risers 2-2" RISERS
 System Type EG 36
 Lineal Footage 208'

This diagram is for office use only.
 It is not to scale & it's accuracy is not guaranteed.

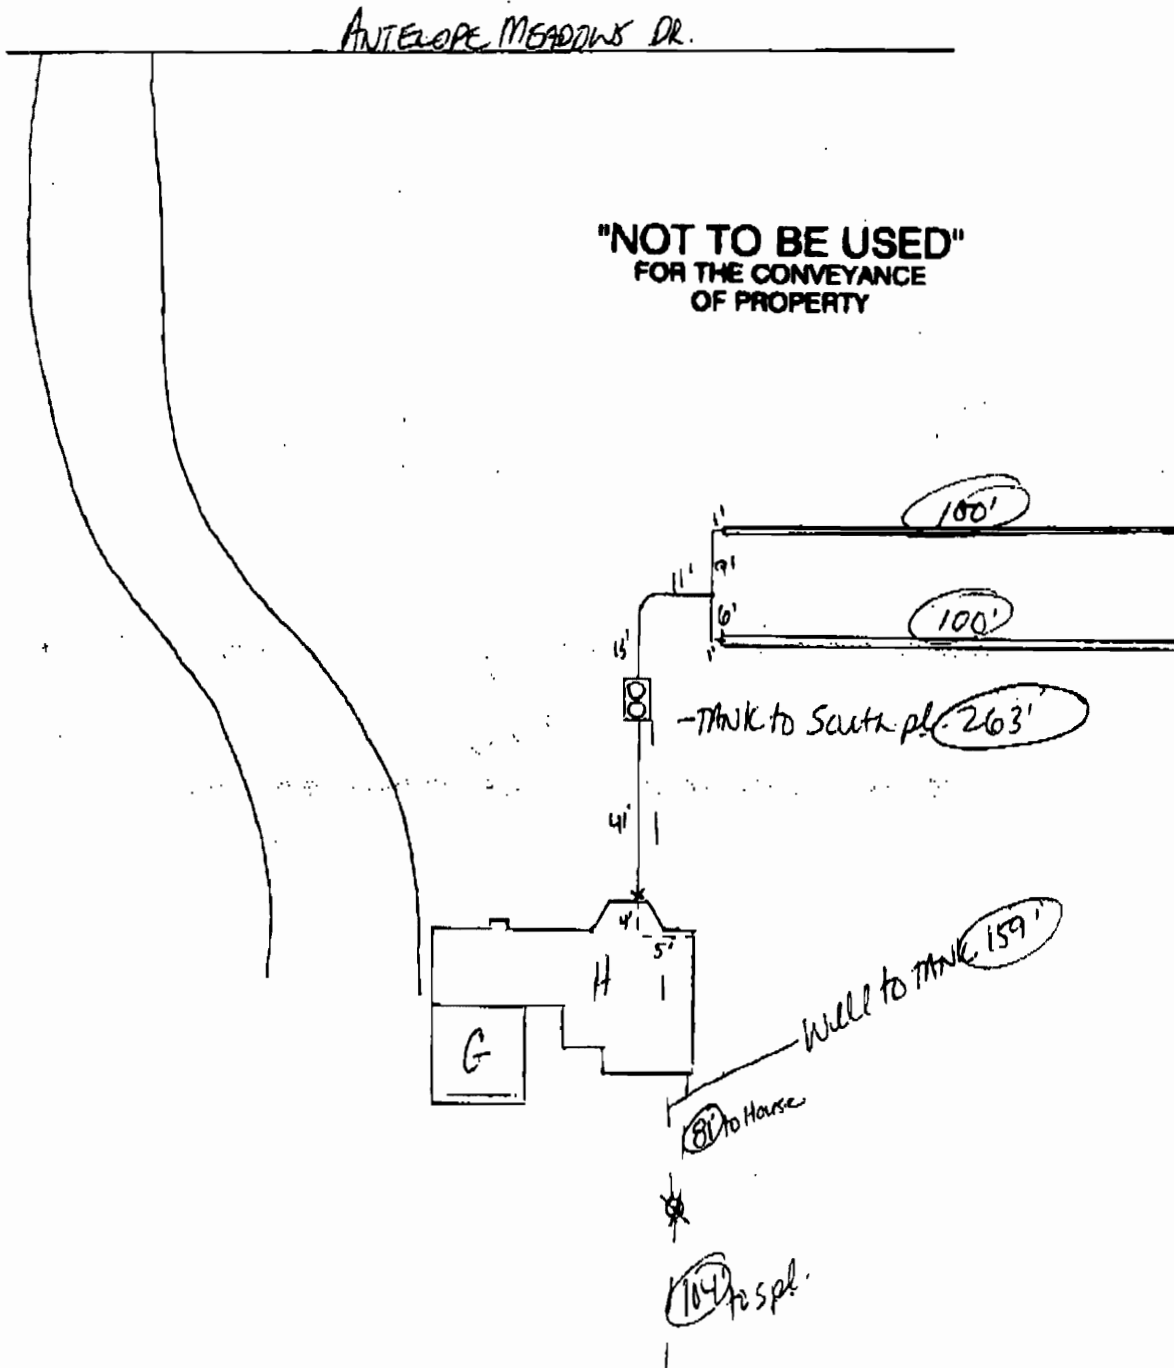

**"NOT TO BE USED"
 FOR THE CONVEYANCE
 OF PROPERTY**